



Al-Mustaqbal University / College of Technical Engineering  
Department of Mechanical Power Engineering Technology  
Class (2<sup>nd</sup>)

Subject (Fundamentals of Air Conditioning and Refrigeration)  
Code (UOMU0201041)

Lecturer (Assist. Prof. Hassan Ghanim Rijabo)  
2<sup>nd</sup> term – Lecture 5 Air Conditioning Plant For Summer and Winter

# Fundamentals of Refrigeration and Air Conditioning

المرحلة الثانية

محاضرة رقم ( 5 )

دورات تكييف الهواء الصيفية والشتوية

**Air-Conditioning Plant for Summer and Winter**





## Fundamentals of Refrigeration and Air Conditioning

Hassan Rijabo

### Lecture 5 Air-Conditioning Plant for Summer and Winter

AL MUSTAQBAL UNIVERSITY  
 College of Engineering and Technology  
 Department of Mechanical Power Engineering

- Hassan.Ghanim.Hassan@uomus.edu.ly
- hvac.eng.edu
- Ref\_AC1

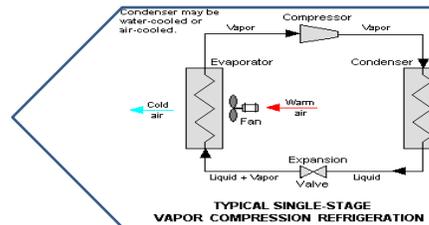


Lecture5. Air-Conditioning Plant for Summer and Winter

In the summer time when cooling is required by the air conditioning plant it will be necessary to operate the cooling coil, reheater and possibly other plant as well.

In winter time the preheater and reheater will probably be on to provide warm air to overcome heat losses.


Other plant may be switched on as well.

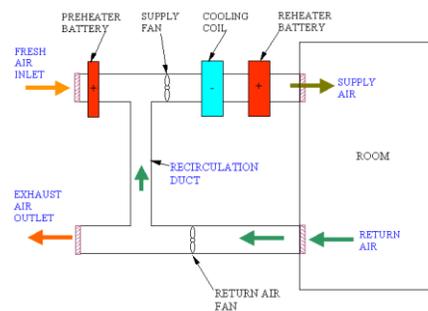



← *Lecture5. Air-Conditioning Plant for Summer and Winter*

The photographs below show some plant items

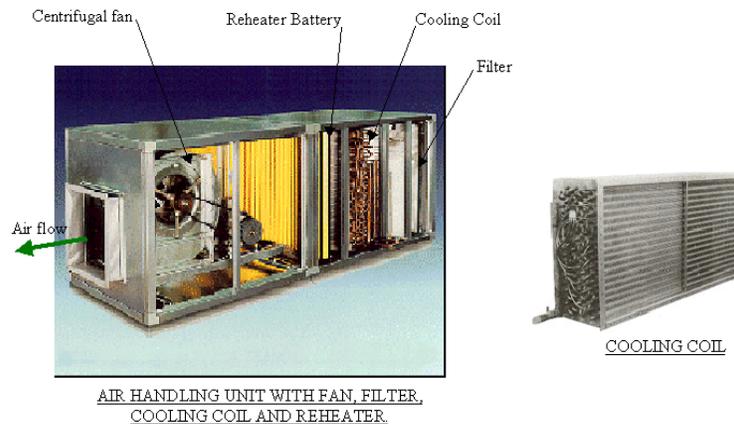

Lec. Hassan Rijabo


3

← *Lecture5. Air-Conditioning Plant for Summer and Winter*

**Cooling Coil Contact Factor**

Some of the air going through a cooling coil does not come into contact with the tubes or fins of the cooling coil and is therefore not cooled to the ADP (Apparatus Dew Point) temperature.

A mixing process therefore takes place as two air streams mix downstream of the cooling coil as shown below.

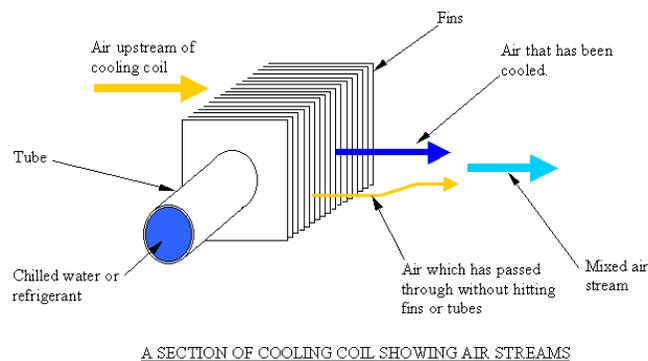

Lec. Hassan Rijabo

4




Lecture 5. Air-Conditioning Plant for Summer and Winter

One air stream is cooled down to the ADP and the other air stream bypasses the coil surfaces to give an off-coil air temperature (mixed air stream) a little higher than the ADP.

This may be looked upon as an inefficiency of the coil and is usually given as the cooling coil contact factor.

The process is shown on the psychrometric chart.

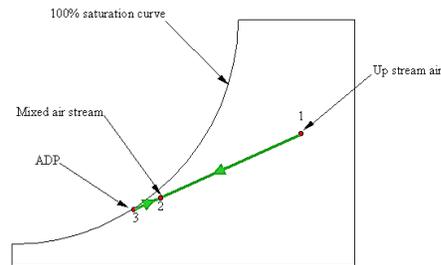

PSYCHROMETRIC CHART SHOWING COOLING COIL CONTACT FACTOR

Lec. Hassan Rijabo

Lecture 5. Air-Conditioning Plant for Summer and Winter


The contact factor of a cooling coil may be found from;

$$\text{Contact Factor (C.F)} = \frac{(h_1 - h_2)}{(h_1 - h_3)}$$

Another expression for contact factor is;

$$\text{By-pass Factor (B.P.F)} = \frac{(h_2 - h_3)}{(h_1 - h_3)}$$

$$\text{C.F} + \text{B.P.F} = 1$$

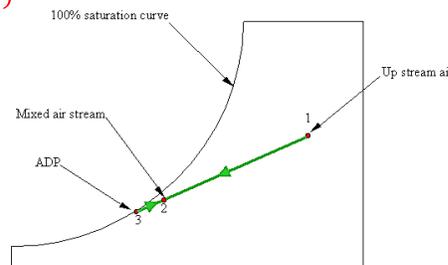

PSYCHROMETRIC CHART SHOWING COOLING COIL CONTACT FACTOR


Lec. Hassan Rijabo



Lecture5. Air-Conditioning Plant for Summer and Winter

### Typical Air Conditioning Processes

The schematic diagram below shows a typical plant system for summer air conditioning.

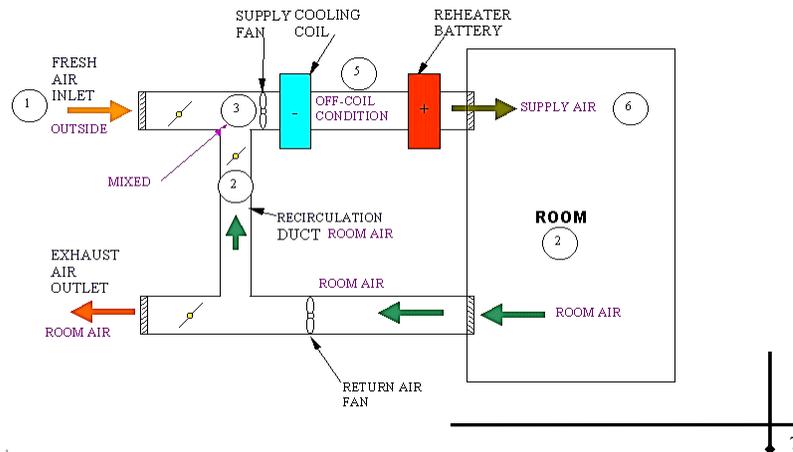


Lec. Hassan Rijabo

Lecture5. Air-Conditioning Plant for Summer and Winter

### Typical Air Conditioning Processes

The psychrometric diagram below shows a typical summer cycle.

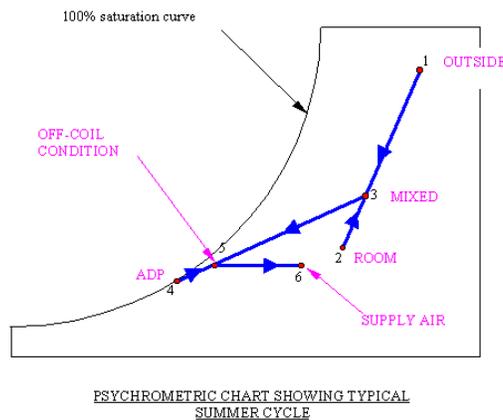


Lec. Hassan Rijabo



Lecture 5. Air-Conditioning Plant for Summer and Winter

### Typical Air Conditioning Processes

The schematic diagram below shows a typical plant system for winter air conditioning.

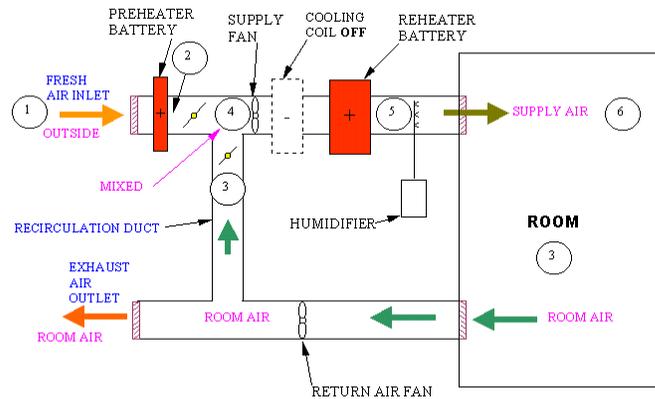


Lec. Hassan Rijabo


Lecture 5. Air-Conditioning Plant for Summer and Winter

### Typical Air Conditioning Processes

The psychrometric diagram below shows a typical winter cycle.


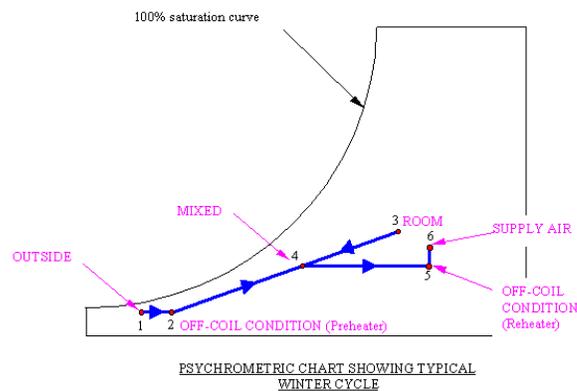


Lec. Hassan Rijabo



### Annotation

Air State point	Letter
Outside	<b>O</b>
Room	<b>R</b>
Mixed	<b>M</b>
Apparatus Dew Point	<b>ADP</b>
Off cooling coil condition	<b>W</b>
Room Ratio Line	<b>RRL</b>
Preheater off coil condition	<b>P</b>
Upstream of Humidifier	<b>H</b>
Supply	<b>S</b>
Duct, fan gain allowance	<b>D</b>



### Room Sensible Heat Ratio

This is the ratio of sensible to total heat in the room for summer or winter.


- The total heat gain (summer) or loss (winter) will be determined by adding the Latent and Sensible heat in a room or rooms, i.e.  
 (SUMMER) Total heat gain = Sensible heat gain + Latent heat gain  
 (WINTER) Total heat = Sensible heat loss + Latent heat gain
- The room ratio is used on a psychrometric chart to determine the supply air state point.
- A room ratio line is superimposed from the protractor on the psychrometric chart onto the main body of the chart by a line passing through the room state point R.





Lecture 5. Air-Conditioning Plant for Summer and Winter

### Room Sensible Heat Ratio (RSHR)

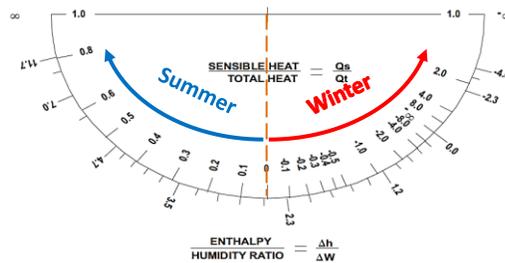


Lec. Hassan Rijabo

13

Lecture 5. Air-Conditioning Plant for Summer and Winter


### Room Sensible Heat Ratio (RSHR)

- An example calculation is as follows:
- Sensible heat gain = 9.0 kW
- Latent heat gain = 2.25 kW
- Total heat gain = 9.0 kW + 2.25 kW = 11.25 kW.
- Room Sensible Heat Ratio (RSHR) = Sensible / Total heat
- Room Sensible Heat Ratio (RSHR) = 9 / 11.25 = 0.8
- The supply air state point must also be somewhere on this room ratio line to meet the room heat gain requirements i.e. the room ratio line always passes through points R and S.

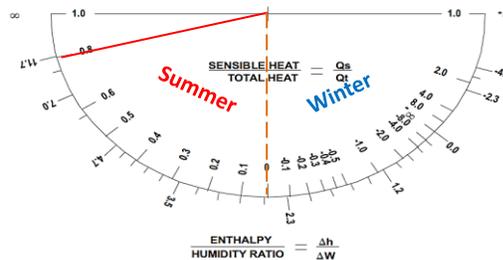

Lec. Hassan Rijabo

14





## Summer and Winter Cycles

### 1. SUMMER CYCLE PSYCHROMETRICS

1. Draw schematic diagram of air-conditioning plant.
2. Plot room condition **R** on psychrometric chart.
3. Plot outside condition **O** on psychrometric chart.
4. Join points **O** and **R**.
5. Find the mix point **M** by measuring the length of the line **O-R** and multiply this by the mixing ratio.  
If there is more recirculated air than outside air at the mix point, then point **M** will be closer to point **R** than point **O**.

Lec. Hassan Rijabo



6. Find the room ratio.  
This is the sensible to total heat gain ratio.  
Plot this ratio on the protractor, bottom segment, on the psychrometric chart and transfer this line onto the chart so that it passes through point **R**.
7. Plot the Apparatus Dew Point **ADP** of the cooling coil.  
This is on the 100% saturation curve.  
The wet bulb and dry bulb temperatures at this point will be equal.
8. Join points **M** and **ADP**.
9. Find the off-coil condition **W** by measuring the length of the line **M-ADP** and multiply this by the cooling coil contact factor.  
Measure down from point **M** to the point **W**.  
The closer the contact factor is to unity, the closer point **W** will be to point **ADP**.
10. Plot the supply air condition **S**.  
The reheater process will be a horizontal line from point **W** to point **S**.  
Point **S** is on the room ratio line.

Lec. Hassan Rijabo





*Lecture 5. Air-Conditioning Plant for Summer and Winter*

TYPICAL AIR HANDLING UNIT

Lec. Hassan Rijabo

*Lecture 5. Air-Conditioning Plant for Summer and Winter*

## 2. SUMMER CYCLE CALCULATIONS

### 2.1 MASS FLOW RATE

When the supply air temperature has been found from the psychrometric chart then the mass flow rate of air can be calculated from the following formula:

$$Q_s = m_a \times C_p (t_r - t_s)$$

where:

- $Q_s$  = Sensible heat gain to room (kW)
- $m_a$  = mass flow rate of air (kg/s)
- $C_p$  = Specific heat capacity of humid air (approx. 1.005 kJ/kg degC)
- $t_r$  = room temperature (°C)
- $t_s$  = supply air temperature (°C)

TYPICAL AIR HANDLING UNIT

Lec. Hassan Rijabo




## 2.2 COOLING COIL OUTPUT

The cooling coil output is as follows:

$$Q_{\text{cooling coil}} = m_a (h_M - h_{ADP})$$

where:

$Q_{\text{cooling coil}}$	=	Cooling coil output (kW)
$m_a$	=	mass flow rate of air (kg/s)
$h_M$	=	specific enthalpy at condition M (kJ/kg)
$h_{ADP}$	=	specific enthalpy at condition ADP (kJ/kg)

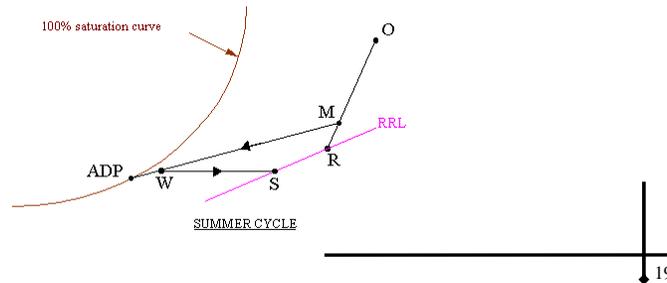

Lec. Hassan Rijabo


## 2.3 HEATER OUTPUT

The reheater output is as follows:

$$Q_{\text{reheater}} = m_a (h_S - h_W)$$

where:

$Q_{\text{reheater}}$	=	Heater output (kW)
$m_a$	=	mass flow rate of air (kg/s)
$h_S$	=	specific enthalpy at condition M (kJ/kg)
$h_W$	=	specific enthalpy at condition W (kJ/kg)

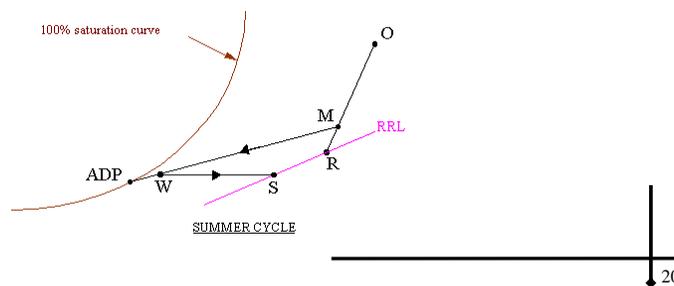

Lec. Hassan Rijabo



## Summer and Winter Cycles

### 3. WINTER CYCLE PSYCHROMETRICS

1. Draw schematic diagram of air-conditioning plant.
2. Plot room condition **R** on psychrometric chart.
3. Plot outside condition **O** on psychrometric chart.
4. Plot the after Preheater condition **P** if there is one in the system. The Preheater process will be a horizontal line from **O** to **P** and will be only a few degrees dry bulb if it acts as a frost coil.
5. Join points **P** and **R**. If there is no frost coil read **O-R** for **P-R**.
6. Find the mix point **M** by measuring the length of the line **P-R** and multiply this by the mixing ratio. If there is more recirculated air than outside air at the mix point, then point **M** will be closer to point **R** than point **P**.



Lec. Hassan Rijabo

21

7. Find the room ratio. This is the sensible to total heat ratio. The total heat for the room will be Sensible loss plus Latent gain. Plot this ratio on the protractor, top segment, on the psychrometric chart and transfer this line onto the chart so that it passes through point **R**.
8. Find the supply air dry bulb temperature by calculation. The mass flow rate of air is the same as that for Summer for a Constant Volume system.
9. Plot the supply air condition **S** on the room ratio line.
10. Plot condition **H** on the psychrometric chart. This is vertically down from point **S**, and horizontally across from point **M**. This is because **M-H** is the reheater process and thus a horizontal line and **H-S** is the humidification process and is close to a vertical line if steam is used.

Lec. Hassan Rijabo

22

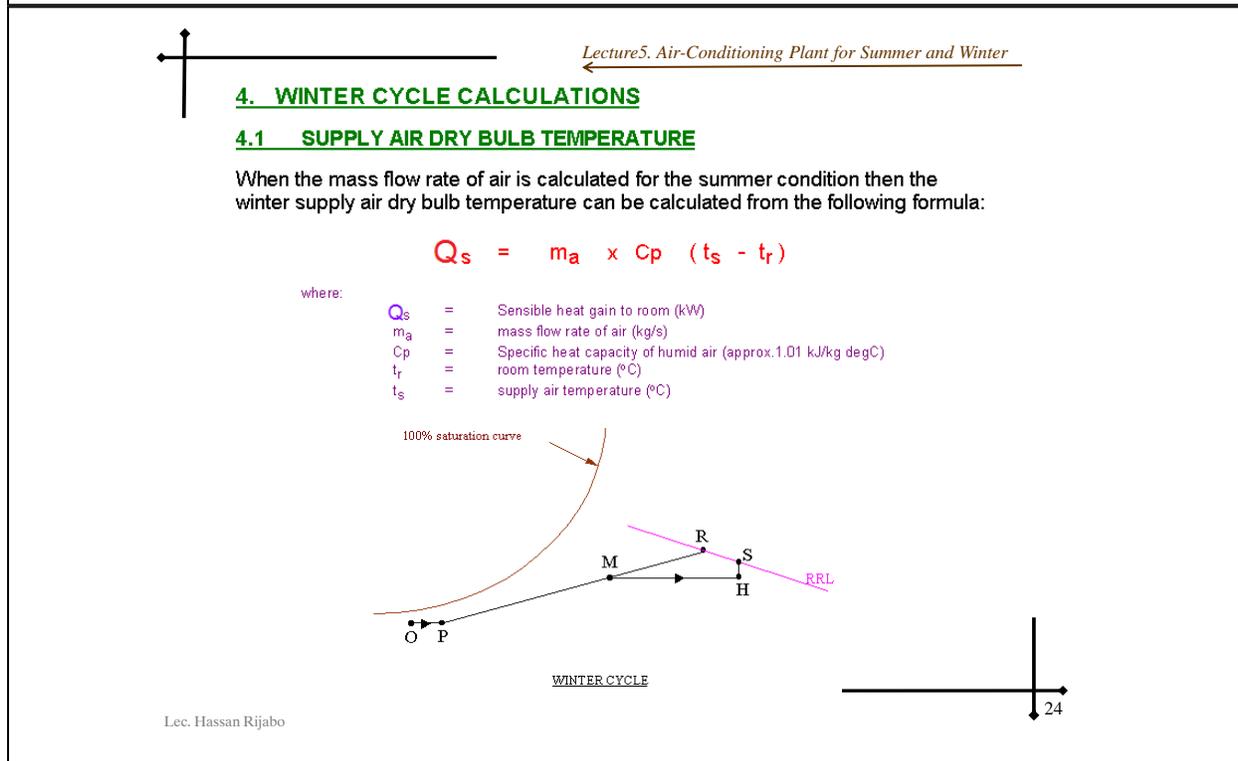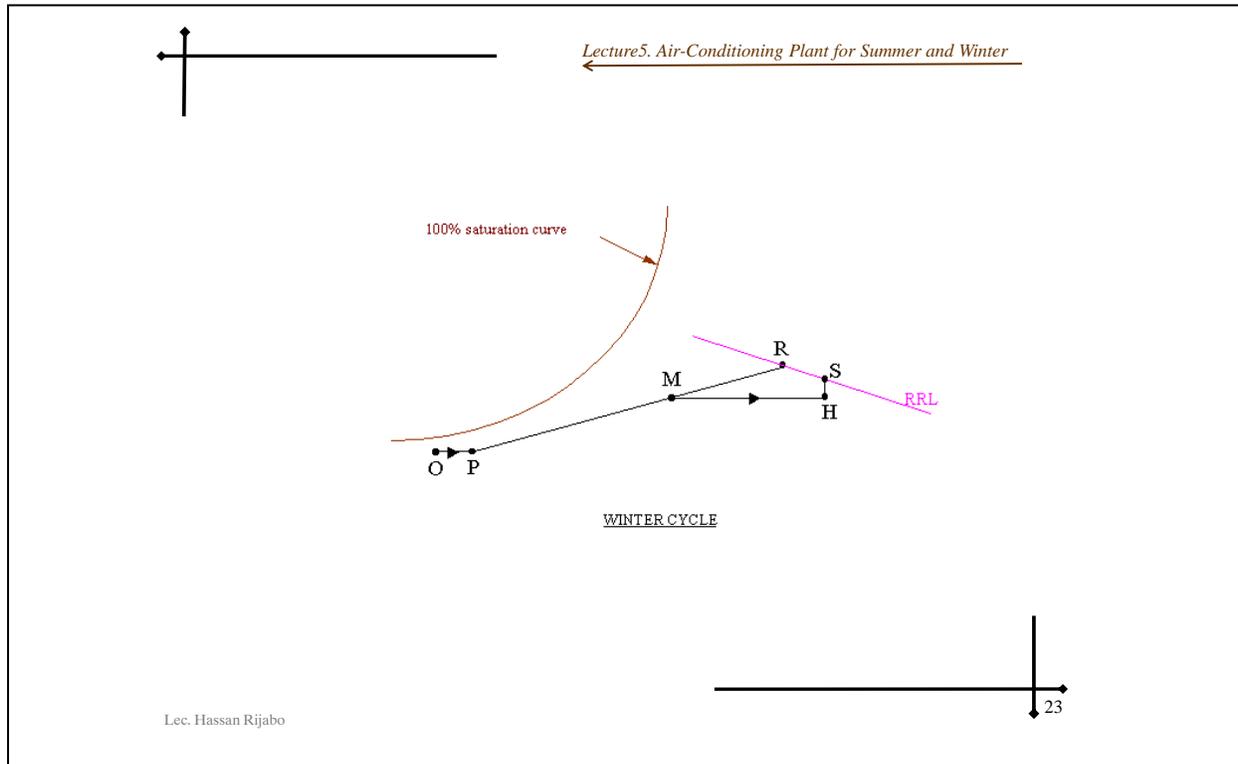




### 4.2 PREHEATER OUTPUT (or frost coil)

The preheater output is as follows:

$$Q_{\text{preheater}} = m_{\text{af}} (h_P - h_O)$$

where:

- $Q_{\text{preheater}}$  = Preheater output (kW)
- $m_{\text{af}}$  = mass flow rate of fresh air (kg/s)
- $h_P$  = specific enthalpy at condition P (kJ/kg)
- $h_O$  = specific enthalpy at condition O (kJ/kg)

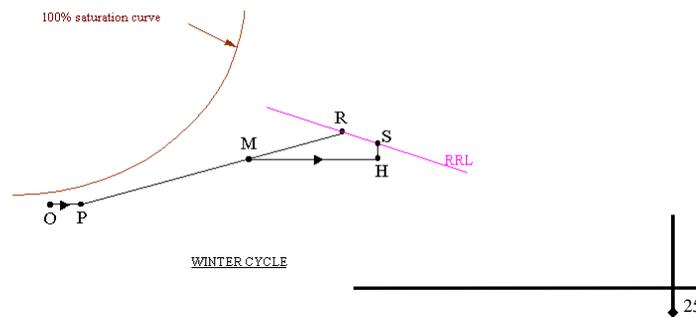

Lec. Hassan Rijabo


### 4.3 REHEATER OUTPUT

The reheater output is as follows:

$$Q_{\text{reheater}} = m_a (h_H - h_M)$$

where:

- $Q_{\text{reheater}}$  = Reheater battery output (kW)
- $m_a$  = mass flow rate of supply air (kg/s)
- $h_H$  = specific enthalpy at condition H (kJ/kg)
- $h_M$  = specific enthalpy at condition M (kJ/kg)

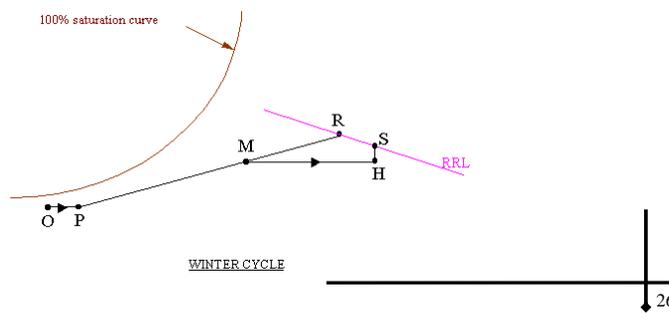

Lec. Hassan Rijabo



4.4 HUMIDIFIER OUTPUT


Lecture 5. Air-Conditioning Plant for Summer and Winter

The amount of moisture added to the air may be calculated from the following formula:

$$m_{\text{moisture added}} = m_a (W_S - W_H)$$

where:

- $m_{\text{moisture added}}$  = The amount of moisture or added or steam flow rate (kg/s)
- $m_a$  = mass flow rate of air (kg/s)
- $W_S$  = moisture content at condition S (kg/kg d.a.)
- $W_H$  = moisture content at condition H (kg/kg d.a.)

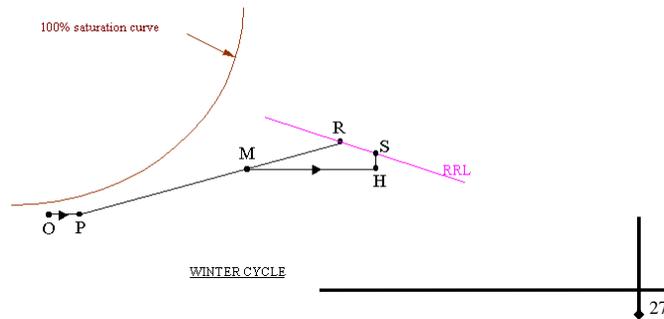

Lec. Hassan Rijabo

27

5. DUCT AND FAN GAINS

Lecture 5. Air-Conditioning Plant for Summer and Winter

Summer and Winter Cycles

5. DUCT AND FAN GAINS


The air in a duct is slightly heated from the fan electric motor and heat is also transmitted through the duct wall from warm areas into the air stream, for example;

a duct contains air at 15°C and passes through a roof space at 30°C in summer.

There will be heat transferred through the duct wall, which increases the air temperature slightly.

To allow for this in the summer psychrometric process an additional sensible heating state point D is added as shown below.

The air may be heated by several °C depending on the fan motor, length of duct and type of duct insulation used, if any. The distance from point W to point D may be typically 1°C to 3°C dry bulb temperature in the U.K.

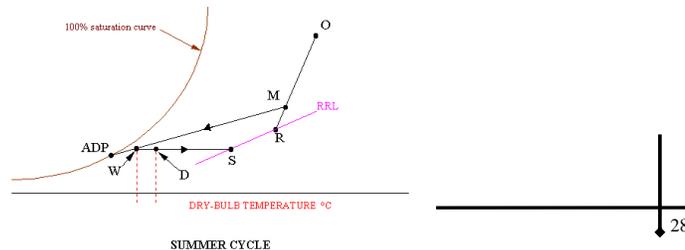

Lec. Hassan Rijabo

28






**Procedure (Summer Cycle)**

*Lecture 5. Air-Conditioning Plant for Summer and Winter*

1. Draw schematic diagram of air-conditioning plant (see above)
2. Plot room condition **R** on psychrometric chart.
3. Plot outside condition **O** on psychrometric chart.
4. Join points **O** and **R**.

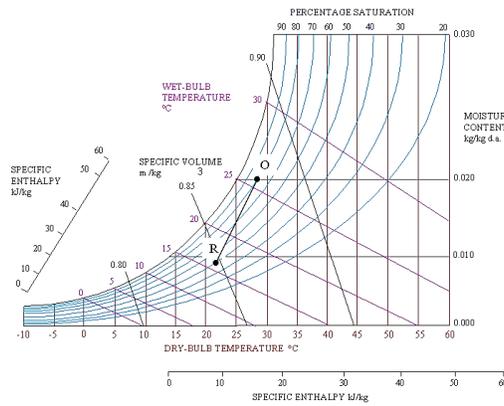

Lec. Hassan Rijabo

31

**5. Find the mixed point M**

$$(0.2 m_M \times h_O) + (0.8 m_M \times h_R) = m_M \times h_M$$

$$h_O = 77 \text{ kJ/kg dry air}, h_R = 43 \text{ kJ/kg dry air} \text{ from psychrometric chart}$$

$$(0.2 \times 77) + (0.8 \times 43) = (1 \times h_M)$$

$$h_M = 50 \text{ kJ/kg dry air}$$

If there is more recirculated air than outside air at the mix point, then point **M** will be closer to point **R** than point **O**.

6. Find the room ratio.  
This is the sensible to total heat gain ratio.

$$\text{Total heat} = 10.8 \text{ kW sensible} + 7.2 \text{ kW latent} = 18 \text{ kW total.}$$

$$\text{Heat ratio} = 10.8 / 18.0 = 0.6$$

Plot this ratio on the protractor, bottom segment, on the psychrometric chart and transfer this line onto the chart so that it passes through point **R**.

Lec. Hassan Rijabo

32

*Lecture 5. Air-Conditioning Plant for Summer and Winter*

- Plot the Apparatus Dew Point **ADP** of the cooling coil.  
 This is on the 100% saturation curve.

The ADP is 8°C.

The wet bulb and dry bulb temperatures at this point will be equal.

- Join points **M** and **ADP**.




TYPICAL SMALL AIR HANDLING UNIT

Lec. Hassan Rijabo

33

*Lecture 5. Air-Conditioning Plant for Summer and Winter*

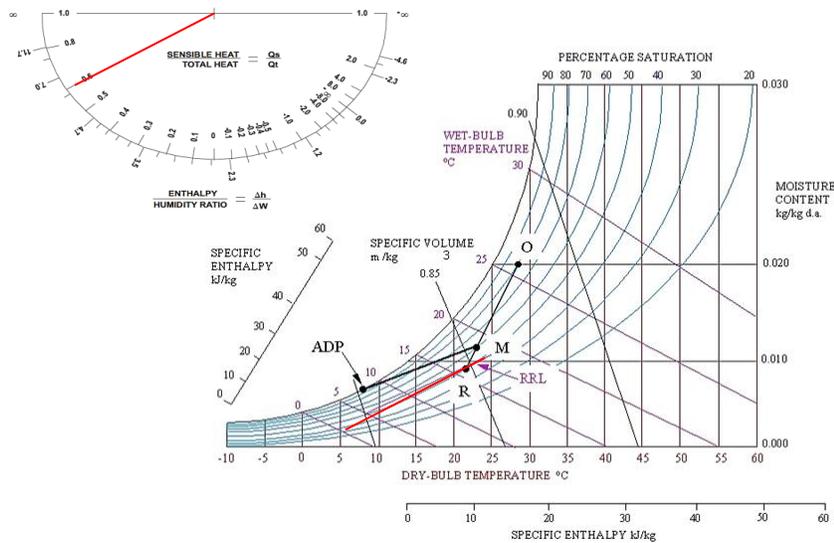


Lec. Hassan Rijabo

34



Lecture 5. Air-Conditioning Plant for Summer and Winter

9. Since there is no cooling coil contact factor we can proceed with reheating from point ADP.
10. Plot the supply air condition **S**.  
The reheater process will be a horizontal line from point **ADP** to point **S**.  
Point **S** is on the room ratio line.  
The supply air temperature is 15°C.

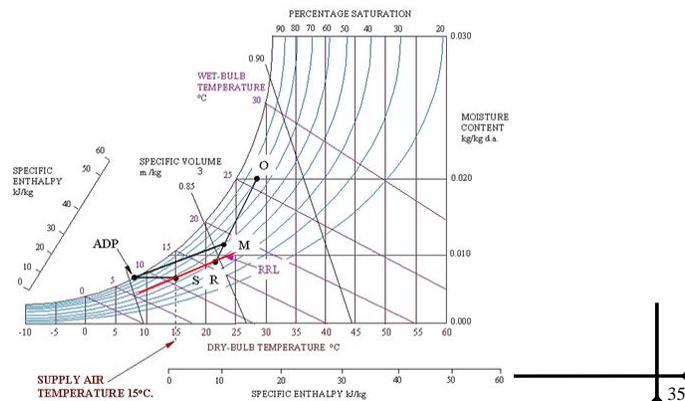

Lec. Hassan Rijabo

Lecture 5. Air-Conditioning Plant for Summer and Winter

**SUMMER CYCLE CALCULATIONS**

**MASS FLOW RATE**

When the supply air temperature has been found from the psychrometric chart then the mass flow rate of air can be calculated from the following formula:

$$Q_s = m_a \times C_p (t_r - t_s)$$

where:

- $Q_s$  = Sensible heat gain to room (kW)
- $m_a$  = mass flow rate of air (kg/s)
- $C_p$  = Specific heat capacity of humid air (approx. 1.005 kJ/kg degC)
- $t_r$  = room temperature (°C)
- $t_s$  = supply air temperature (°C)

The supply air temperature is 15°C.

Rearranging the above formula gives:

$$m_a = Q_s / (C_p (t_r - t_s))$$

$$m_a = 10.8 / (1.005 (22 - 15))$$

$$m_a = 1.528 \text{ kg/s}$$

Lec. Hassan Rijabo



### COOLING COIL OUTPUT

*Lecture5. Air-Conditioning Plant for Summer and Winter*

The cooling coil output is as follows:

$$Q_{\text{cooling coil}} = m_a (h_M - h_{ADP})$$

where:

- $Q_{\text{cooling coil}}$  = Cooling coil output (kW)
- $m_a$  = mass flow rate of air (kg/s)
- $h_M$  = specific enthalpy at condition M (kJ/kg)  
determined from psychrometric chart
- $h_{ADP}$  = specific enthalpy at condition ADP (kJ/kg)  
determined from psychrometric chart


The specific enthalpies at points **M** and **ADP** are shown on the psychrometric Chart below.

$$Q_{\text{cooling coil}} = 1.528 (50 - 25)$$

$$Q_{\text{cooling coil}} = \underline{38.2 \text{ kW}}$$

Lec. Hassan Rijabo

37



### Note:

*Lecture5. Air-Conditioning Plant for Summer and Winter*

The cooling coil output of 38.2 kW is a much higher value than the sensible heat gain of 10.8 kW.

It should be remembered that the difference in these two values is mostly from the fresh air cooling load.

It takes quite a lot of energy in summer to cool fresh air coming into air handling units.

This can be minimized by bringing in minimum fresh air but not too little otherwise the building will suffer from lack of oxygen and feel stuffy.

Sometimes mistakes are made when sizing cooling apparatus.

If a cooling coil or indoor cooling unit is sized on the sensible heat gain only without allowing for fresh air load then it will be grossly undersized.

That is why psychrometric charts are required to calculate cooling coil output including fresh air loads.

So, don't size cooling coil and indoor cooling units on sensible heat gain only if there is fresh air coming into the plant.

Size these items of plant using a psychrometric chart.

Lec. Hassan Rijabo

38



Lecture 5. Air-Conditioning Plant for Summer and Winter

**HEATER OUTPUT**

The heater or reheater output is as follows:

$$Q_{\text{heater}} = m_a (h_S - h_{\text{ADP}})$$

where:

- $Q_{\text{heater}}$  = Heater output (kW)
- $m_a$  = mass flow rate of air (kg/s)
- $h_S$  = specific enthalpy at condition S (kJ/kg)  
determined from psychrometric chart.
- $h_{\text{ADP}}$  = specific enthalpy at condition ADP (kJ/kg)  
determined from psychrometric chart.

The specific enthalpies at points ADP and S are shown on the psychrometric Chart below.

$$Q_{\text{heater}} = 1.528 (31.5 - 25)$$

$$Q_{\text{heater}} = \underline{9.932 \text{ kW}}$$

Lec. Hassan Rijabo

39

Lecture 5. Air-Conditioning Plant for Summer and Winter

**Example 2. Winter Cycle**

A room has a 18.0 kW sensible heat loss in winter and a 4.5 kW latent heat gain from the occupants.

Determine the supply air temperature and heater load using the following information.


DATA:

Indoor condition: 21°C dry-bulb temperature, 50% saturation.

Outdoor condition: -2°C d.b., 80% saturation.

The outdoor air and recirculated air ratio is 20%/80%.

No preheating or humidification takes place in this simplified example.

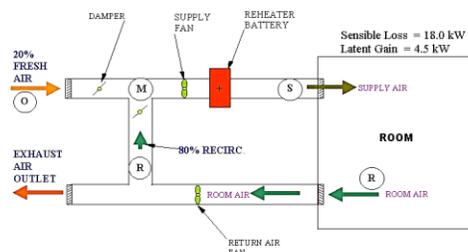

Lec. Hassan Rijabo


40



Lecture 5. Air-Conditioning Plant for Summer and Winter

**Procedure (Winter Cycle)**

1. Draw schematic diagram of air-conditioning plant (see above)
2. Plot room condition R on psychrometric chart.
3. Plot outside condition O on psychrometric chart.
4. No Preheater condition P
5. Join points O and R

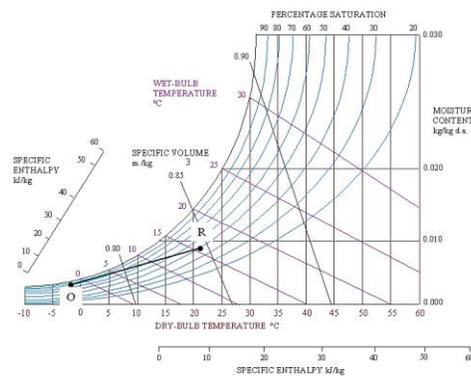

Lec. Hassan Rijabo

41

Lecture 5. Air-Conditioning Plant for Summer and Winter

**6. Find the mixed point M**

$h_o = 4.4 \text{ kJ/kg dry air}$  ,  $h_R = 40.8 \text{ kJ/kg dry air}$  from psychrometric chart

$$(0.2 m_M \times h_o) + (0.8 m_M \times h_R) = m_M \times h_M$$

$$(0.2 \times 4.4) + (0.8 \times 40.8) = (1 \times h_M)$$

$$h_M = 34 \text{ kJ/kg dry air}$$

**7. Find the room sensible ratio line**

$$RSHR = \frac{Q_{sensible}}{Q_{sensible} + Q_{latent}}$$

$$RSHR = \frac{-18}{(-18) + (4.5)}$$


$$RSHR = 1.33$$

Lec. Hassan Rijabo

42



Lecture 5. Air-Conditioning Plant for Summer and Winter

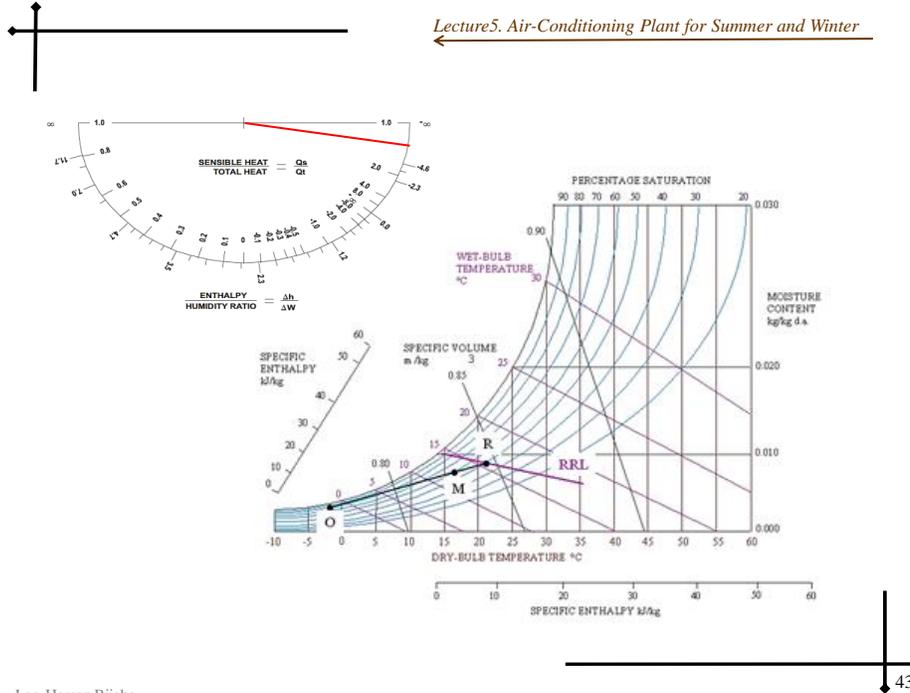


Lec. Hassan Rijabo

43


Lecture 5. Air-Conditioning Plant for Summer and Winter

8. Find the supply air dry bulb temperature by calculation.
9. Plot the supply air condition S on the room ratio line.  
This is on a horizontal line from point M to the right hand side of the chart, and intersects with the RRL.  
The supply air Temperature is found to be 32.5°C.

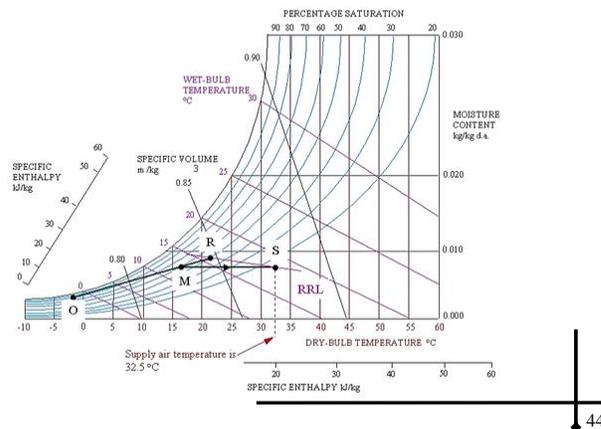

Lec. Hassan Rijabo

44



**Supply Air Flow Rate**

When the sensible heat loss and supply air temperature in winter are known then the mass flow rate of air is calculated from the following formula:

$$Q_s = m_a \times C_p (t_s - t_r)$$

where:


- $Q_s$  = Sensible heat loss (kW)
- $m_a$  = mass flow rate of air (kg/s)
- $C_p$  = Specific heat capacity of humid air (approx. 1.005 kJ/kg degC)
- $t_r$  = room temperature (°C)
- $t_s$  = supply air temperature (°C) .....therefore:

$$m_a = Q_s / C_p (t_s - t_r)$$


$$m_a = 18 / 1.005 (32.5 - 21)$$

$$m_a = 18 / 11.615$$

$$m_a = 1.55 \text{ kg/s}$$



Lec. Hassan Rijabo



**Heater Output**

The heater output is as follows:

$$Q_{\text{reheater}} = m_a (h_s - h_M)$$

where:

- $Q_{\text{reheater}}$  = Reheater output (kW)
- $m_a$  = mass flow rate of air (kg/s)
- $h_s$  = specific enthalpy at condition S (kJ/kg)
- $h_M$  = specific enthalpy at condition M (kJ/kg)



The specific enthalpies at points S and M are shown on the psychrometric chart.

$$Q_{\text{heater}} = m_a (h_S - h_M)$$

$$Q_{\text{heater}} = 1.55 (50 - 34)$$

$$Q_{\text{heater}} = 24.8 \text{ kW}$$

Therefore the heater load is **24.8 kW**.

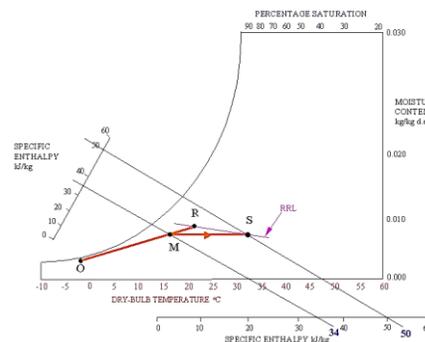

Lec. Hassan Rijabo